



Control Panels with AB CD Terminals



Connection to the switch (Forced ON, A & B)
P1 1

Control panels with modular Clocks


Type 1

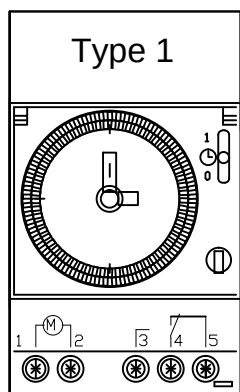

P1 1

Parallel connection to the NO contact of the timer.


Type 2

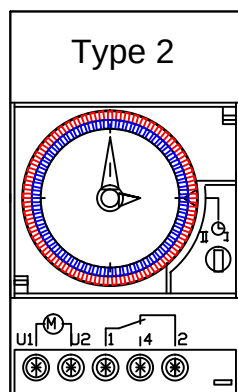

P1 1

Control Panels with a built-in clock


Type 1




P1 1

Parallel connection to the NO contact of the timer.

Type 2



P1 1

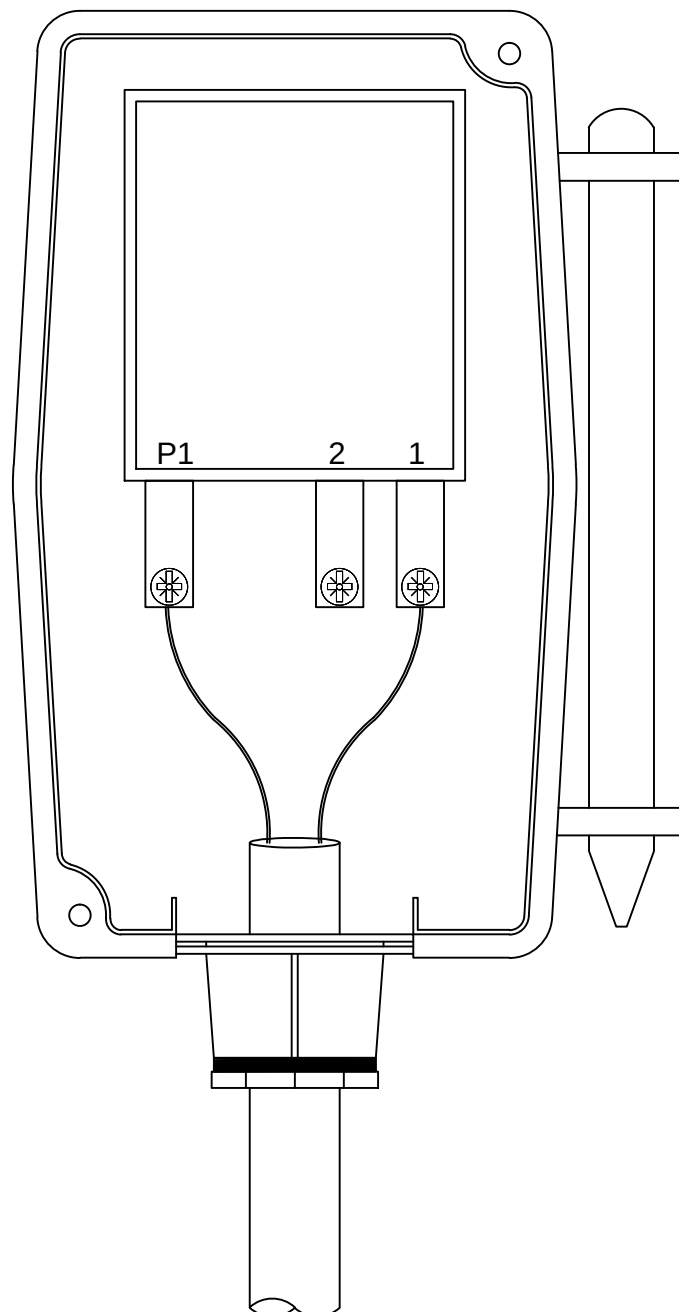

Connect the wires to the terminals (P1 - 1)